

**CONFORMED DRAWING**  
08/02/98  
SIGNED AND SEALED  
COPY IS KEPT ON FILE

ORIGINAL SIGNED & SEALED BY  
N.Y. P.E. (OR E.A.)

**Joseph R. Loring  
& Associates, Inc.**  
consulting engineers  
One Pennsylvania Plaza  
New York, New York 10119-0045  
Tel: (212) 742-7400, Fax: (212) 742-7362

THE OFFICE OF  
**DAVID  
BLIET  
LEBOWITZ  
P.C.**  
CONSULTING ENGINEERS  
100 WALL STREET, 10TH FLOOR  
NEW YORK, N.Y. 10038

**LESLIE E. ROBERTSON  
ASSOCIATES, R.L.P.**  
CONSULTING ENGINEERS  
300 WEST 10TH STREET  
NEW YORK, N.Y. 10014  
TEL: (212) 675-1000 FAX: (212) 675-1001

No.	Date	Revision	Approved

Engineering Department  
Design Division

**The  
World  
Trade  
Center**


**STANDBY POWER  
5 WORLD TRADE CENTER**

**PLUMBING**


**5 WTC PART PLAN  
FUEL OIL TANK ROOM**

This drawing is subject to conditions in contract.  
As variations, design changes and methods  
herein are reserved to Port Authority and  
may not be used without its written consent.

VP	W.A.P.	VP
Designed by	Drawn by	Check by
Date	Scale	
11/17/97	AS SHOWN	
Contract Number	Drawing Number	
WTC-845.071	P2-01	

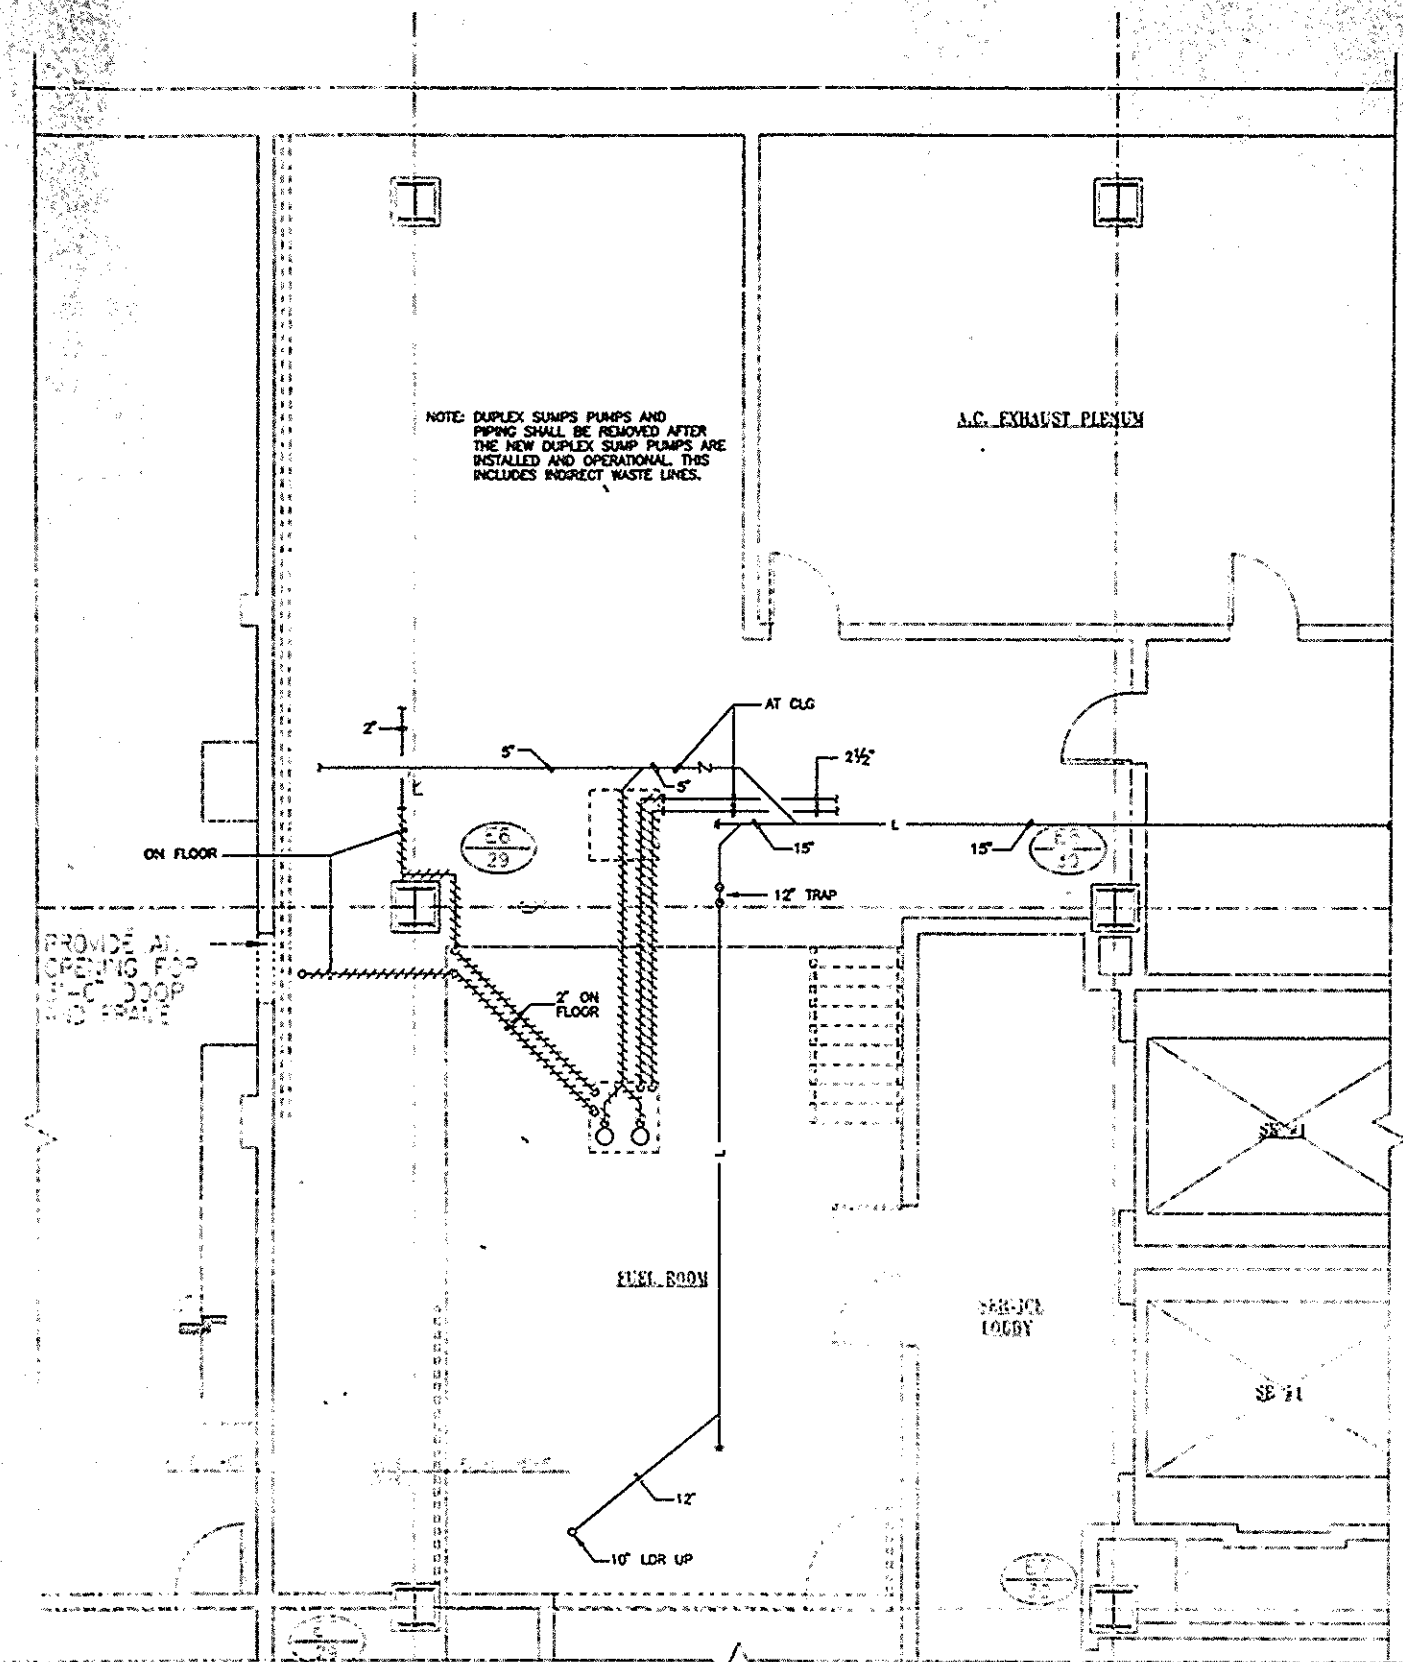


**REMOVAL PLAN  
FUEL OIL TANK ROOM**

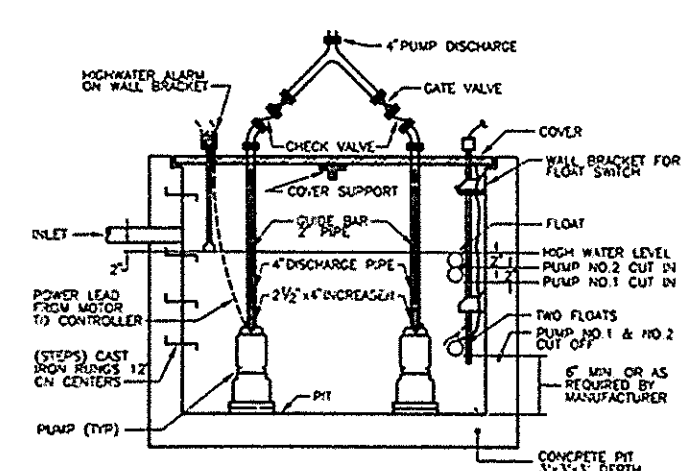

**DUPLEX SUBMERSIBLE SUMP PUMPS  
NOT TO SCALE**

- NOTES:
- CONTROL PANEL WITH NEMA 1 ENCLOSURE SHALL BE INSTALLED WHERE SHOWN
  - STEEL BASIN COVER SHALL BE A GRATING WITH OPENINGS AS REQUIRED FOR DISCHARGE PIPING, INLET PIPING (SAME AS FOR EXISTING SUMP PIT) AND CONTROLS
  - EACH PUMP SHALL BE AS FOLLOWS: 100 GPM, 30 FT HD, 1750 RPM, 1 1/2 HP, 460 VOLTS, 3 PH, 60 HZ., FEDERAL PUMP CORP. MODEL VSS-2120-11 1/2-4.

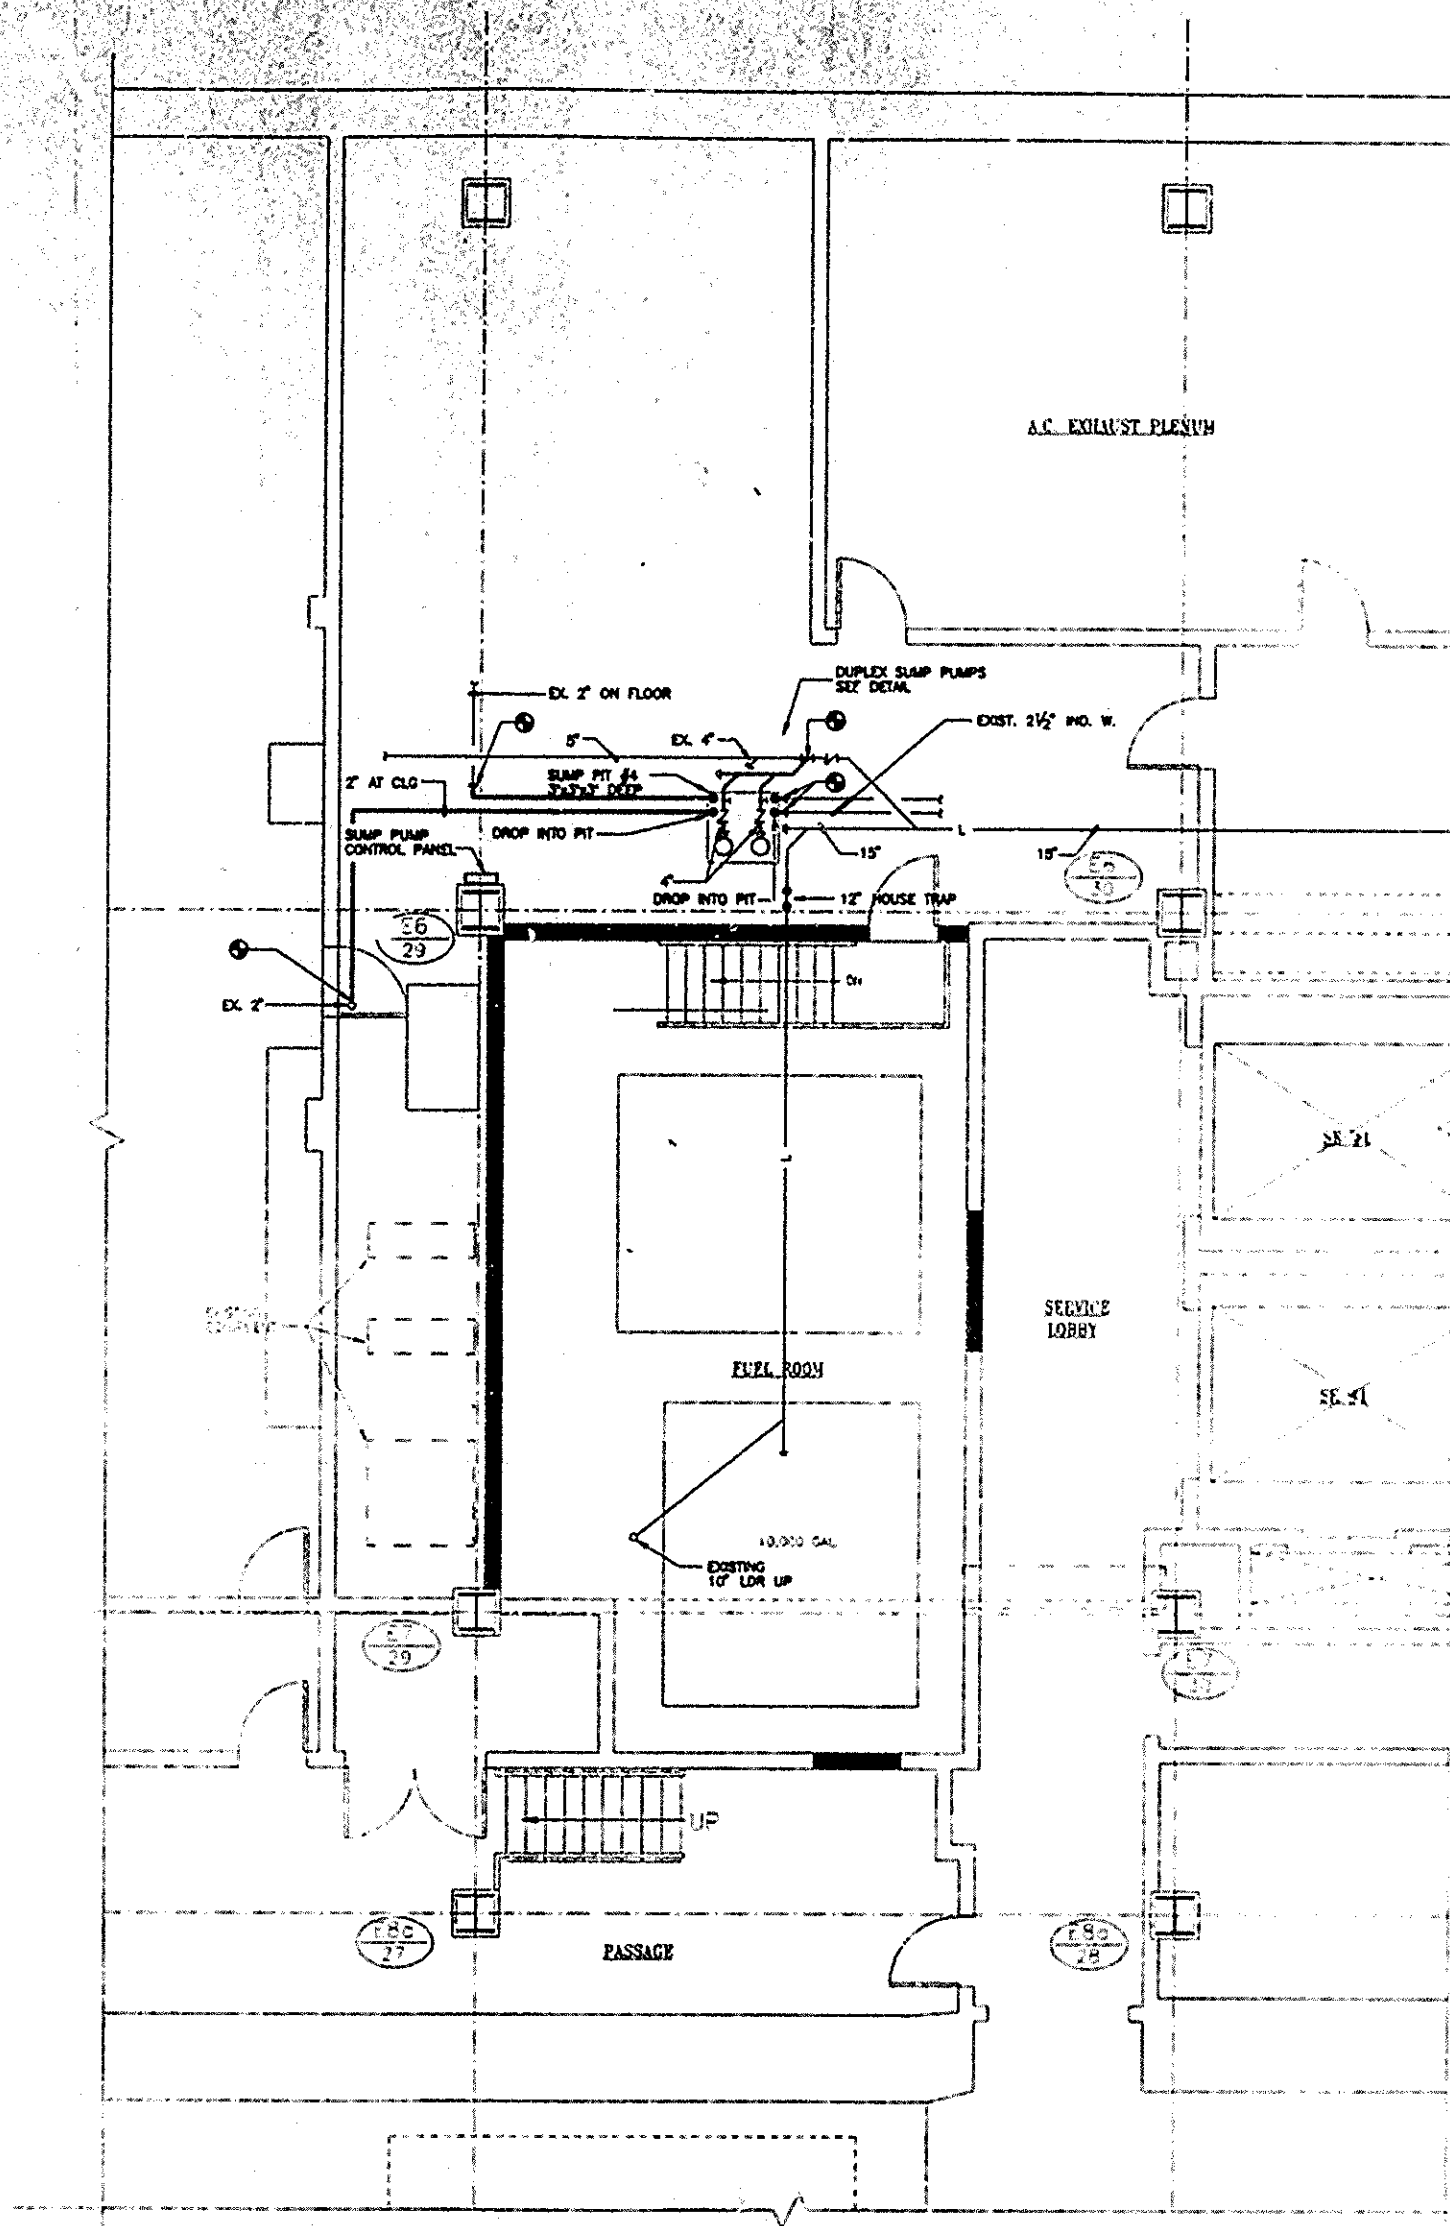

**5 WTC PART PLAN B2 LEVEL  
FUEL OIL TANK ROOM**

